

3M

Fire Protection Products



Technical Service Bulletin No.: 06-1017

Title: Accelerated Aging and High Humidity Conditioning of 3M Fire Protections Intumescent Products

Date: May 19, 2006

Issued by: Brandon Cordts

TITLE: ACCELERATED AGING AND HIGH HUMIDITY CONDITIONING OF 3M FIRE PROTECTIONS INTUMESCENT PRODUCTS

DESCRIPTION: Effective May 23, 2006, the new environmental/accelerated aging protocol for intumescent products goes into effect in the Third Edition of the Standard for Fire Tests of Through Penetration Firestops, ANSI/UL 1479.

This is a new requirement from UL mandating that all intumescent products listed for use according to ANSI/UL 1479 be exposed to elevated temperature and humidity levels for an extended period of time and then evaluated for their intumescent performance. Non-intumescent products that are listed for use according to ANSI/UL 1479 are not required to be subjected to the accelerated aging protocol. Based on this new requirement, 3M submitted the pertinent intumescent products for accelerated aging and high humidity conditioning and then subsequent evaluation of the intumescent performance of the products after the conditioning. 3M successfully passed the testing protocol and is in compliance with the new requirements that will be in effect May 23, 2006. Please see the attached letter from UL for validation of 3M Fire Protection Products compliance with this requirement.

THIS BULLETIN IS BEING SENT TO: 3M Fire Protection Products Authorized L-2 Distributors
3M Fire Protection Products Authorized National Distributors
3M Fire Protection Products Authorized L-1 Distributors
3M Sales Representatives
3M Manufacturer's Representatives
3M St. Paul Internal
3M International

3M Building Safety Solutions Department
3M Center, Building 223-2S-24
St. Paul, MN 55144-1000



Northbrook Division
333 Pfingsten Road
Northbrook, IL 60062-2096 USA
www.ul.com
tel: 1 847 272 8800

May 17, 2006

3M Company
Mr. Brandon Cordts
3M Center
Bldg 207-1W-02
St Paul, MN 55144

Our Reference: R9700, R9269

Subject: Product Status – Aging Review Program


Dear Mr. Cordts:

This will confirm that the following products have been found to comply with all of the requirements, including the new environmental exposure/accelerated aging protocol, in the Third Edition of the Standard for Fire Tests of Through-Penetration Firestops, ANSI/UL 1479, Dated May 23, 2006:

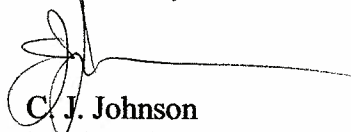
CP 25WB+ Caulk, IC 15WB+ Caulk, FS-195+ Wrap Strip, Ultra GS Wrap Strip, PPD Firestop Devices and Ultra PPD Firestop Devices, CS-195+ Composite Sheet

If you have any further questions, please contact us.

Very truly yours:


Margaret Figueroa
Staff Engineer
Fire Protection Division

Reviewed by:


C. J. Johnson
Lead Engineering Associate
Fire Protection Division

