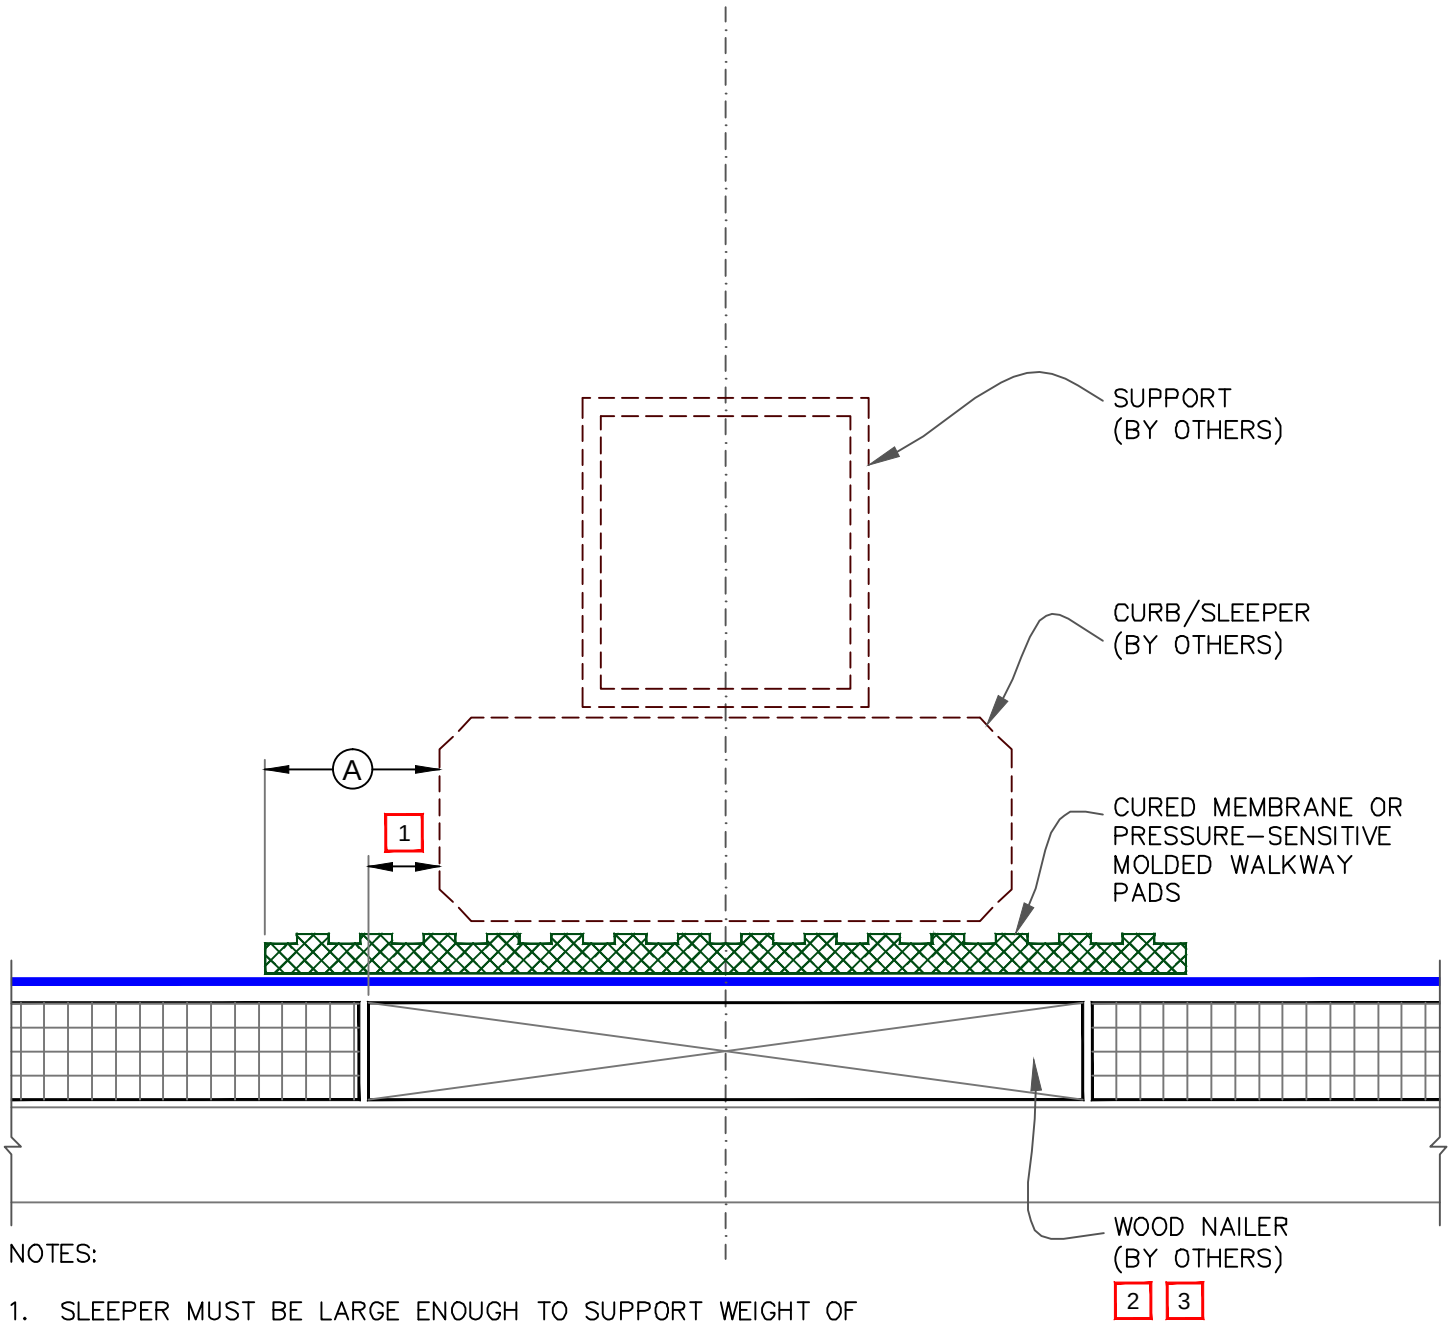

NOTES:

1. SLEEPER MUST BE LARGE ENOUGH TO SUPPORT WEIGHT OF EQUIPMENT WITHOUT INDENTING INSULATION. EXTEND WOOD NAILER OUT AS REQUIRED BY STRUCTURAL ENGINEER TO DISTRIBUTE SUBJECT LOAD OR AT LEAST EXTEND OUT MIN. 3" (76mm).
2. ENSURE SCREW/ANCHOR HEADS IN TOP SURFACE OF WOOD BLOCKING ARE RECESSED TO PROTECT MEMBRANE.
3. WOOD NAILERS NOT REQUIRED UNDER PIPE SUPPORTS.
4. CONSULT STRUCTURAL ENGINEER AND/OR SPECIFIER TO AVOID WATER PONDING DUE TO DECK DEFLECTION.

DIMENSIONS		mm	
A	3"	76	MIN.

EPDM APPROVED SUBSTRATE 0 SEE NOTE(S)	SLEEPER For additional information, refer to Specifications	DETAIL NO. U-24 THERMOSET UNIVERSAL

© 2011 Carlisle SynTec, a division of Carlisle Construction Materials Incorporated