



TECHNICAL BULLETIN 110

PROPER TESTING FOR Compressive Strength

Five Star® Epoxy Grouts should be tested for compressive strength using 2" x 2" cube specimens made in brass or steel cube molds and a cover plate as directed in ASTM C 579, Method B. The use of cover plates on cube molds ensures more accurate testing and is highly recommended. The use of cylinders, plastic molds, or curing at temperatures below 70°F (21°C) will all result in lower compressive strengths being reported.

The most critical aspect of testing epoxy grouts for compressive strength is the rate at which epoxy cube specimens are loaded; ASTM C 579 specifically designates one of two load rates only:

Load Rate I: 6000 psi per minute load rate

Load Rate II: 0.1 to 0.125 inches per minute crosshead speed x specimen height (2 inches) = 0.20 to 0.25 inches per minute for a 2 inch epoxy grout cube

ASTM C 579 further states about the two load rate methods: "the above load rates are not identical and may produce different compressive strength results."


Since Five Star Products, Inc. tests and reports compressive strength data based upon Load Rate II, it is highly recommended that any testing facility have its compression tester calibrated to Load Rate II when testing Five Star® Epoxy Grouts. At no time should epoxy grouts ever be tested using a load rate other than what is specified in ASTM C 579. Using load rates other than that specified in ASTM C 579, such as load rates for cement-based grouts (ASTM C 109), concrete or other materials will result in much lower compressive strengths reported.

A. Equipment Required for Testing

- 2" x 2" brass or steel cube mold and cover plate (plastic molds or plastic inserts not acceptable)
- Release agent
- Compression Testing Machine calibrated to Load Rate II
- Curing Location Temperature 70°F - 77°F (21°C - 25°C)

B. Test Time Tolerances

- 1 day ± ½ hour (from start time)
- 7 days ± 3 hours (from start time)

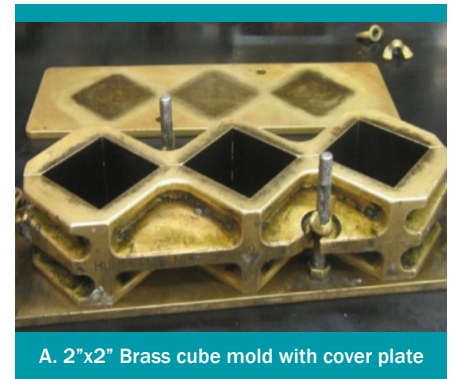

A. 2"x2" Brass cube mold with cover plate

Five Star Technical Bulletins are provided for informational purposes only and should be used as general guidelines for consideration by contractors and engineers. While every reasonable effort has been made to ensure this information is accurate and authoritative, Five Star Products does not warrant the accuracy or completeness of this information, or its appropriateness for any particular purpose. The user of these documents remains solely responsible for the specification of all methods, materials and practices.

FIVE STAR PRODUCTS, INC.
60 Parrott Drive
Shelton, CT 06484 USA
Phone: +1 203-336-7900
Support: 1-800-243-2206 (IN THE U.S.)

TECHNICAL BULLETIN 110

C. Compressive Strength Requirement

- Refer to Technical Data Sheet of product being tested.

D. Testing Procedure

1. Using mold release agent, spray cube mold and cover plate.
2. Fill all cube molds halfway with epoxy grout. Tamp or rod epoxy grout in mold using tongue depressor or tamping rod to remove any entrapped air. Fill mold full with epoxy grout and tamp / rod second layer into first layer. Remove any entrapped air. Fill molds to a slightly overfill condition.
3. Strike off excess epoxy grout from mold.
4. Screed off epoxy grout with tongue depressor or margin trowel using sawing motion so the surface of epoxy grout is flush with the top of the mold.
5. Clean off any excess material on the top of the mold.
6. Place the cover plate on the mold and tighten with screws or clamps.
7. Move the mold to a nearby job site trailer or similar area where temperatures are above 65°F (18°) and leave undisturbed for 24 hours. DO NOT transport newly cast cube specimens of epoxy grout for 24 hours.
8. Identify cubes with product name, batch code, amount of aggregate, start time, test date and temperature.
9. Leave mold undisturbed for 24 hours.
10. De-mold cubes after 24 hours and test one cube. The other cube is tested at 7 days and the other is held as a retain or can be tested at 28 days. Confirm proper calibration of compression tester where required.
11. When testing cubes do not apply the load to the original top or bottom cube surfaces (rotate cubes 90° before loading in compression tester).
12. Record the compressive strength in pounds per square inch by dividing the cross sectional area by load.



D.2. Fill molds halfway with epoxy grout, then tamp or rod to remove entrapped air.



D.4. Screed off excess grout.



D.6. Place cover plate on mold and tighten with screws or clamps.

For information 1-800-243-2206 • FiveStarProducts.com