


Mechanically Fastened and Fully Adhered Details

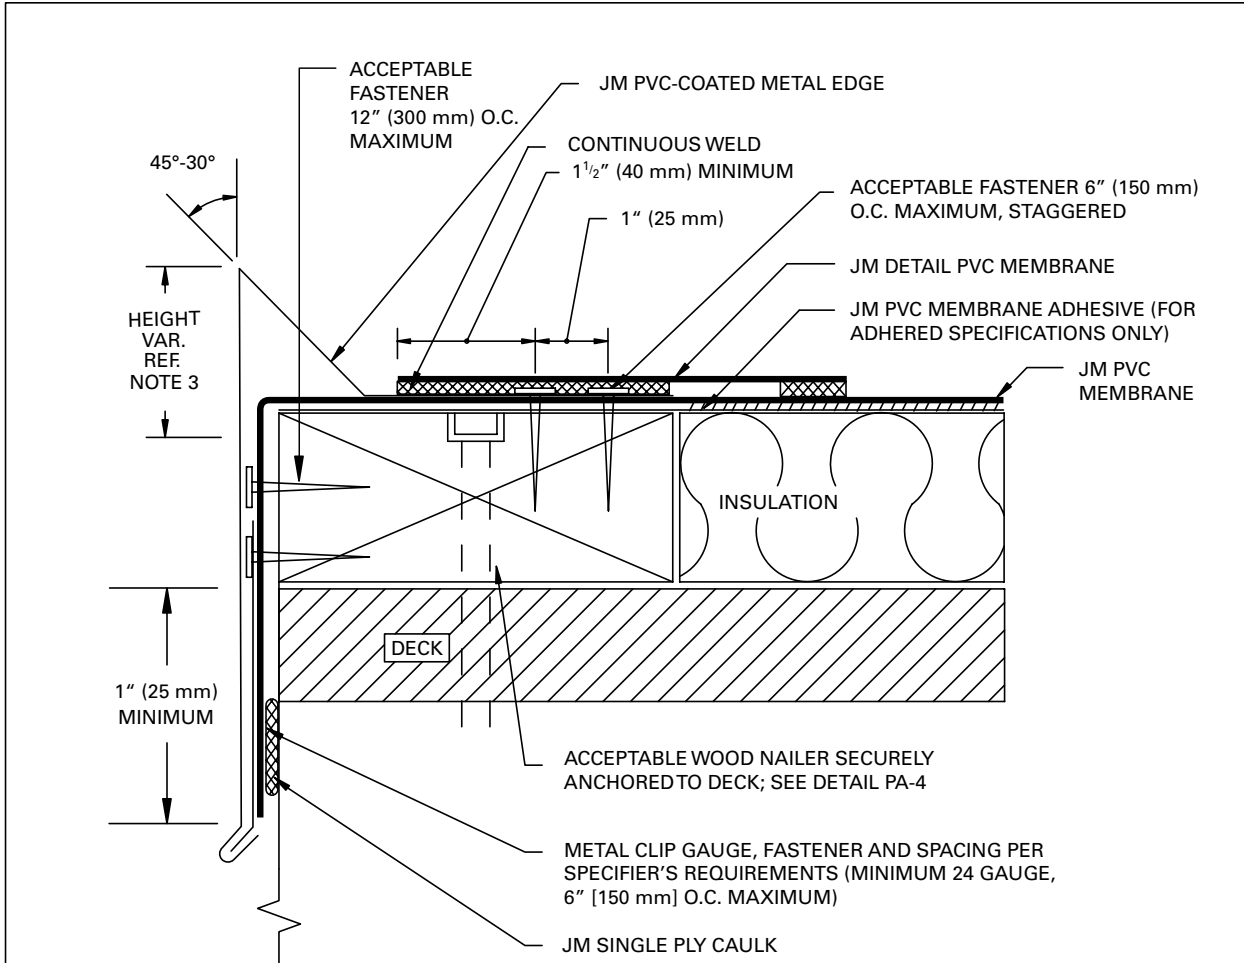

NOTES:

1. DETAILS TO BE USED IN CONJUNCTION WITH GUIDE SPECIFICATIONS CONTAINING REQUIREMENTS FOR NAILERS, INSULATION, ETC.
2. FOR JM PVC-COATED METAL JOINT, SEE DETAIL PE-17.
3. APPLICATOR/SPECIFIER TO DETERMINE HEIGHT REQUIRED TO PREVENT WATER FROM CASCADING OVER BUILDING EDGE.
4. PRECAUTIONS MUST BE TAKEN TO ENSURE THAT THE MINIMUM 6" (150 mm) WIDE MEMBRANE COVER STRIP IS NOT WELDED SOLID. A 2" (50 mm) WIDE UNWELDED AREA MUST BE MAINTAINED BETWEEN THE TWO WELDED EDGES OF THE COVER STRIP.

| | | | | |
|-----------------------------|-------------------------------------|--------------------|----------------|---------------------------------------------------------------------------------------|
| DRAWING NO. PE-11 | PVC-COATED METAL/GRAVEL STOP | | |  |
| | SCALE N.T.S. | ISSUE DATE 3-06 | CAD PV11MEF | |