Mechanically Fastened and Adhered Details

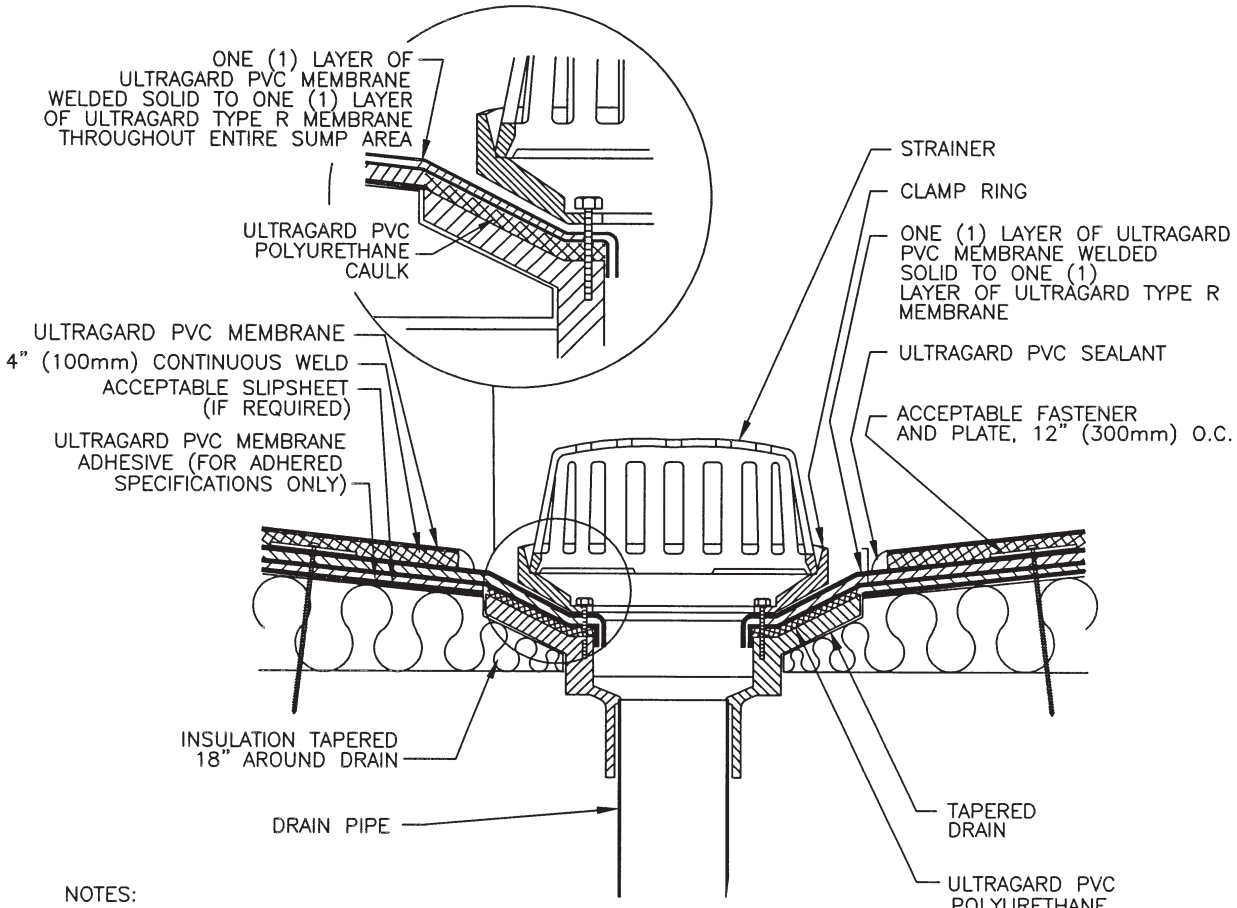

NOTES:

1. DETAILS TO BE USED IN CONJUNCTION WITH GUIDE SPECIFICATIONS CONTAINING REQUIREMENTS FOR NAILERS, INSULATION, SLIPSHEETS, ETC.
2. ULTRAGARD PVC SEALANT IS REQUIRED ON ALL CUT OR NON–ENCAPSULATED EDGES OF REINFORCED MEMBRANE. THIS INCLUDES FACTORY CUT MEMBRANE.
3. FIELD MEMBRANE SEAMS MUST NOT RUN THRU DRAIN BOWL.
4. ALL MEMBRANE CUTS MUST BE ROUNDED TO PREVENT TEARING. OLD LEADS MUST BE REMOVED AND FLANGE CLEANED OF ASPHALT.
5. REPLACE ANY BROKEN COMPONENTS (DRAINS, RINGS, BOLTS, ETC.)
6. SUMP AREA MUST BE PROPERLY TAPERED SO THAT THE DRAIN FLASHING IS NOT INSTALLED UNDER TENSION.
7. DETAIL MUST NOT BE USED WHERE COAL TAR PITCH IS PRESENT. SEE DETAIL PF–57

DRAWING NO.	UltraGard® ROOF DRAIN (REROOF)		
PF-56	SCALE N.T.S.	ISSUE DATE 5–1–98	CAD PV56MEF

Johns Manville