


**362PWS134-21NS, 55 ksi**

Overall Depth  
PWS PrimeWall® (EQ) Stud  
Flange Width  
Material Thickness

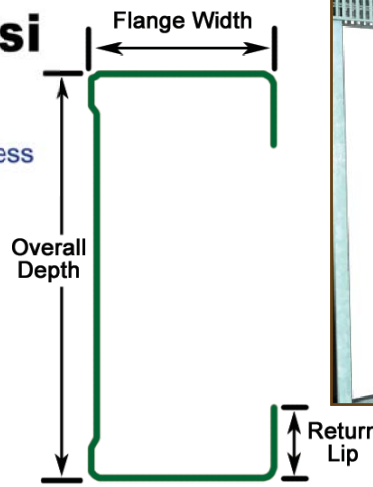


**Material Composition**

ASTM A653/A 653M Structural Steel Grade 55 (380), with 55ksi (380MPa) minimum yield strength and 70ksi (480MPa) minimum tensile strength. Coating is G40 (Z120) hot-dipped galvanized, or equivalent conforming to ASTM C 645. Steel material with G60 and G90 coating are available upon request.

Physical Properties of Non-Standard Non-Structural CFS Framing Members														
Section	Mil Thickness	Design Thickness	Gross Properties						Effective Properties		Moments			
			Area	Weight	I <sub>x</sub>	R <sub>x</sub>	I <sub>y</sub>	R <sub>y</sub>	I <sub>xd</sub>	S <sub>x</sub>	Allowable M <sub>n</sub>	Nominal M <sub>n</sub>	Dist. Buck. M <sub>nd</sub>	Unbraced Length L <sub>u</sub>
			(in <sup>2</sup> )	(lbs/ft)	(in <sup>4</sup> )	(in)	(in <sup>4</sup> )	(in)	(in <sup>4</sup> )	(in <sup>3</sup> )	(in-k)	(in-k)	(in-k)	(in)
162PWS134-21NS, 55ksi	21	0.0221	0.102	0.346	0.048	0.689	0.025	0.493	0.041	0.037	1.21	2.02	2.17	24.7
250PWS134-19NS, 55ksi	19	0.0200	0.116	0.395	0.120	1.019	0.031	0.517	0.110	0.065	2.15	4.04	3.60	27.3
362PWS134-19NS, 55ksi	19	0.0200	0.138	0.471	0.283	1.430	0.035	0.504	0.254	0.094	3.09	5.17	5.34	26.6
400PWS134-19NS, 55ksi	19	0.0200	0.146	0.497	0.356	1.562	0.036	0.498	0.313	0.104	3.43	5.72	5.92	26.5
600PWS134-21NS, 55ksi	21	0.0221	0.205	0.699	1.027	2.237	0.045	0.466	0.851	0.169	5.57	9.29	10.59	25.7

**Table Notes**

1. Section properties and nominal moments are based on AISI S100-07.
2. Superscript "1" denotes that the web height-to-thickness ratio exceeds 260.
3. Strength increase due to cold-work of forming is not considered in the analysis.
4. Standard punchouts are considered in the calculation of nominal moments.
5. Rotational stiffness (k<sub>r</sub>) is taken equals to zero for calculation of the distortional buckling moment.
6. PWS stud is considered fully braced when the unbraced length is less than the listed L<sub>u</sub>.

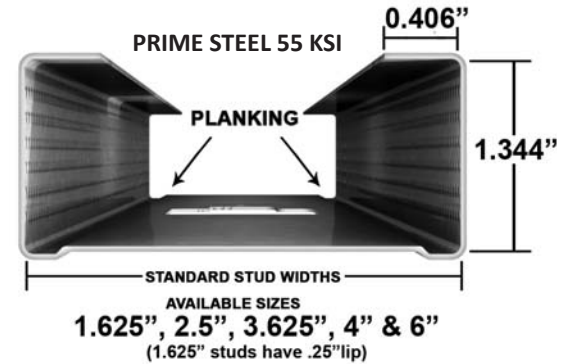

Allowable Ceiling Spans													
Section	F <sub>y</sub> (ksi)	4 psf						6 psf					
		Lateral Support of Compression Flange						Lateral Support of Compression Flange					
		Unsupported			Midspan			Unsupported			Midspan		
		Joist Spacing (in.) o.c.			Joist Spacing (in.) o.c.			Joist Spacing (in.) o.c.			Joist Spacing (in.) o.c.		
<b>L/240</b>													
162PWS134-21NS, 55ksi	55	8' 1" f	7' 6" f	6' 7" f	8' 9"	7' 11"	6' 11"	7' 3" f	6' 7" f	5' 10" f	7' 8"	6' 11"	6' 1"
250PWS134-19NS, 55ksi	55	9' 6" f	8' 9" f	7' 11" f	12' 1"	11' 0"	9' 7"	8' 6" f	7' 11" f	7' 1" f	10' 7"	9' 7"	8' 5"
362PWS134-19NS, 55ksi	55	10' 4" f	9' 7" f	8' 7" f	14' 3" f	13' 1" f	11' 8" f	9' 3" f	8' 7" f	7' 8" f	12' 8" f	11' 8" f	10' 4" f
400PWS134-19NS, 55ksi	55	10' 7" f	9' 10" f	8' 10" f	14' 8" f	13' 6" f	12' 0" f	9' 6" f	8' 10" f	7' 11" f	13' 0" f	12' 0" f	10' 8" f
600PWS134-21NS, 55ksi	55	12' 6" f	11' 7" f	10' 5" f	17' 4" f	16' 0" f	14' 4" f	11' 3" f	10' 5" f	9' 4" f	15' 6" f	14' 4" f	12' 10" f
<b>L/360</b>													
162PWS134-21NS, 55ksi	55	7' 8"	6' 11"	6' 1"	7' 8"	6' 11"	6' 1"	6' 8"	6' 1"	5' 3"	6' 8"	6' 1"	5' 3"
250PWS134-19NS, 55ksi	55	9' 6" f	8' 9" f	7' 11" f	10' 7"	9' 7"	8' 5"	8' 6" f	7' 11" f	7' 1" f	9' 3"	8' 5"	7' 4"
362PWS134-19NS, 55ksi	55	10' 4" f	9' 7" f	8' 7" f	14' 0"	12' 9"	11' 1"	9' 3" f	8' 7" f	7' 8" f	12' 3"	11' 1"	9' 8"
400PWS134-19NS, 55ksi	55	10' 7" f	9' 10" f	8' 10" f	14' 8" f	13' 6" f	11' 11"	9' 6" f	8' 10" f	7' 11" f	13' 0" f	11' 11"	10' 5"
600PWS134-21NS, 55ksi	55	12' 6" f	11' 7" f	10' 5" f	17' 4" f	16' 0" f	14' 4" f	11' 3" f	10' 5" f	9' 4" f	15' 6" f	14' 4" f	12' 10" f

**Table Notes**

1. "f": flexure controls, "s": shear controls. No letter next to the allowable span means deflection controls.
2. All values are based on total load of assembly, not including storage or accessible ceilings.
3. All values are for simple spans, with compression flange either unbraced or braced at midspan.

Allowable Loads for Screw Connections (pounds per screw)														
Member Style (Thickness designator)	Design Thickness (in)	Min. Thickness (in)	Yield	Tensile	#6 Screw (0.138" dia.; 1/4" head)			#8 Screw (0.164" dia.; 5/16" head)			#10 Screw (0.190" dia.; 0.340" head)			C645 Screw Test (P, F)
			F <sub>y</sub> (ksi)	F <sub>u</sub> (ksi)	Shear (lbs)	Pullout (lbs)	Pullover (lbs)	Shear (lbs)	Pullout (lbs)	Pullover (lbs)	Shear (lbs)	Pullout (lbs)	Pullover (lbs)	
19	0.0200	0.0190	55	70	97	55	175	112	65	219	121	75	238	Pass
21	0.0221	0.0210	55	70	107	60	193	127	72	242	140	83	263	Pass

**Table Notes**

1. Data is based on calculated values in accordance with AISI S100-07 Section E4 for equal thicknesses joined together.
2. Pullover capacities are based on concentrically loaded connections that produce a uniform pull-over force on the fastener.

Table Notes cont'd

3. The edge distance, e, is taken as 1.5 times the screw shank diameter.
4. The design thickness, t, is used in the calculation of the allowable pullout strength.
5. The effective pullover resistance diameter, d<sub>w</sub>, is taken as the screw head diameter.
6. C645 screw penetration test is based on 3<sup>rd</sup> party independent testing.

Non-Composite Fully Braced Walls											
Section	L <sub>w</sub>	Spacing	5 psf			7.5 psf			10 psf		
	(in)	(in o.c.)	L/120	L/240	L/360	L/120	L/240	L/360	L/120	L/240	L/360
162PWS134-21NS, 55ksi	24.7	12	10' 3"	8' 1"	7' 1"	8' 11"	7' 1"	6' 2"	8' 1"	6' 5"	5' 7"
	24.7	16	9' 4"	7' 4"	6' 5"	8' 1"	6' 5"	5' 7"	7' 4"	5' 10"	5' 1"
	24.7	24	8' 1"	6' 5"	5' 7"	7' 1"	5' 7"	4' 11"	6' 4" f	5' 1"	4' 5"
250PWS134-19NS, 55ksi	27.3	12	14' 2"	11' 3"	9' 10"	12' 5"	9' 10"	8' 7"	11' 3"	8' 11"	7' 9"
	27.3	16	12' 10"	10' 3"	8' 11"	11' 3"	8' 11"	7' 9"	10' 3"	8' 1"	7' 1"
	27.3	24	11' 3"	8' 11"	7' 9"	9' 9" f	7' 9"	6' 10"	8' 5" f	7' 1"	6' 2"
362PWS134-19NS, 55ksi	26.6	12	18' 9"	14' 11"	13' 0"	16' 5"	13' 0"	11' 4"	14' 4" f	11' 10"	10' 4"
	26.6	16	17' 1"	13' 6"	11' 10"	14' 4" f	11' 10"	10' 4"	12' 5" f	10' 9"	9' 4"
	26.6	24	14' 4" f	11' 10"	10' 4"	11' 8" f	10' 4"	9' 0"	10' 1" f	9' 4"	8' 2"
400PWS134-19NS, 55ksi	26.5	12	20' 2"	16' 0"	13' 11"	17' 5" f	13' 11"	12' 2"	15' 1" f	12' 8"	11' 1"
	26.5	16	18' 4"	14' 6"	12' 8"	15' 1" f	12' 8"	11' 1"	13' 1" f	11' 6"	10' 1"
	26.5	24	15' 1" f	12' 8"	11' 1"	12' 4" f	11' 1"	9' 8"	10' 8" f	10' 1"	8' 9"
600PWS134-21NS, 55ksi	25.7	12	27' 2" f	22' 4"	19' 6"	22' 2" f	19' 6"	17' 0"	19' 3" f	17' 8"	15' 5"
	25.7	16	23' 7" f	20' 3"	17' 8"	19' 3" f	17' 8"	15' 5"	16' 8" f	16' 1"	14' 0"
	25.7	24	19' 3" f	17' 8"	15' 5"	15' 8" f	15' 5"	13' 6"	13' 7" f	13' 7" f	12' 3"

**Table Notes**

1. "f": flexure controls, "s": shear controls. No letter next to the allowable height means deflection controls.
2. All values are calculated based on AISI S100-07: steel properties only.
3. Web crippling is not considered.
4. Based on bracing of the stud not to exceed L<sub>w</sub>.
5. The factory punchouts are in accordance with AISI S201-07 Section C5. The distance from the center of the last punchout to the end of the stud is 12".

Non-Composite Walls Braced at 4' on Center											
Section	Similar to SFIA	Spacing	5 psf			7.5 psf			10 psf		
		(in o.c.)	L/120	L/240	L/360	L/120	L/240	L/360	L/120	L/240	L/360
162PWS134-21NS, 55ksi	162S125-30	12	10' 3"	8' 1"	7' 1"	8' 11"	7' 1"	6' 2"	7' 11" f	6' 5"	5' 7"
		16	9' 4"	7' 4"	6' 5"	7' 11" f	6' 5"	5' 7"	6' 11" f	5' 10"	5' 1"
		24	7' 11" f	6' 5"	5' 7"	6' 6" f	5' 7"	4' 11"	5' 7" f	5' 1"	4' 5"
250PWS134-19NS, 55ksi	250S125-30	12	14' 2"	11' 3"	9' 10"	12' 5"	9' 10"	8' 7"	11' 3"	8' 11"	7' 9"
		16	12' 10"	10' 3"	8' 11"	11' 3"	8' 11"	7' 9"	9' 11" f	8' 1"	7' 1"
		24	11' 3"	8' 11"	7' 9"	9' 5" f	7' 9"	6' 10"	8' 1" f	7' 1"	6' 2"
362PWS134-19NS, 55ksi	362S125-30	12	18' 5" f	14' 11"	13' 0"	15' 0" f	13' 0"	11' 4"	13' 0" f	11' 10"	10' 4"
		16	15' 11" f	13' 6"	11' 10"	13' 0" f	11' 10"	10' 4"	11' 3" f	10' 9"	9' 4"
		24	13' 0" f	11' 10"	10' 4"	10' 7" f	10' 4"	9' 0"	9' 2" f	9' 2" f	8' 2"
400PWS134-19NS, 55ksi	400S125-30	12	19' 4" f	16' 0"	13' 11"	15' 9" f	13' 11"	12' 2"	13' 8" f	12' 8"	11' 1"
		16	16' 9" f	14' 6"	12' 8"	13' 8" f	12' 8"	11' 1"	11' 10" f	11' 6"	10' 1"
		24	13' 8" f	12' 8"	11' 1"	11' 2" f	11' 1"	9' 8"	9' 8" f	9' 8" f	8' 9"
600PWS134-21NS, 55ksi	600S125-30	12	27' 0" f	22' 4"	19' 6"	22' 1" f	19' 6"	17' 0"	19' 1" f	17' 8"	15' 5"
		16	23' 5" f	20' 3"	17' 8"	19' 1" f	17' 8"	15' 5"	16' 6" f	16' 1"	14' 0"
		24	19' 1" f	17' 8"	15' 5"	15' 7" f	15' 5"	13' 6"	13' 6" f	13' 6" f	12' 3"

**Table Notes**

1. "f": flexure controls, "s": shear controls. No letter next to the allowable height means deflection controls.
2. All values are calculated based on AISI S100-07: steel properties only.
3. Web crippling is not considered.
4. Values based on discrete bracing of 48" o.c. restraining lateral and lateral/torsional buckling.
5. The factory punchouts are in accordance with AISI S201-07 Section C5. The distance from the center of the last punchout to the end of the stud is 12".